


# Submittal

## ATFS-F Fantom IQ<sup>™</sup>, TITAN<sup>™</sup> Programmed ECM Motor

Ultra Quiet Fan Powered Terminal, Series Flow Analog Control, Pressure Independent

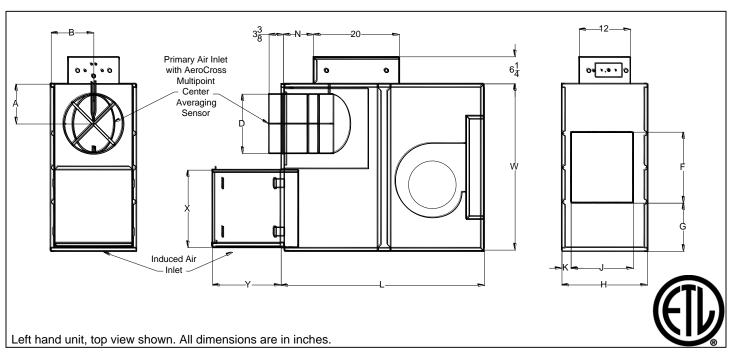

Unit Size	Inlet Size	Α	В	Х	Υ	D	Induced Height		F	G	Н	J	K	L	N	W	Filter Size
В	6 8 10 12	6 6 7 8	- 8	19	13 <sup>7</sup> / <sub>8</sub>	5 <sup>7</sup> / <sub>8</sub> 7 <sup>7</sup> / <sub>8</sub> 9 <sup>7</sup> / <sub>8</sub> 11 <sup>7</sup> / <sub>8</sub>	_ 1′2 °/-	8 <sup>3</sup> / <sub>4</sub>	14	11 <sup>1</sup> / <sub>2</sub>	16	11	2 1/4	43	2 <sup>7</sup> / <sub>8</sub> 2 <sup>7</sup> / <sub>8</sub> 4 <sup>7</sup> / <sub>8</sub> 4 <sup>7</sup> / <sub>8</sub>	37	11 x 14
С	6 8 10 12	6 6 7 8				5 <sup>7</sup> / <sub>8</sub> 7 <sup>7</sup> / <sub>8</sub> 9 <sup>7</sup> / <sub>8</sub> 11 <sup>7</sup> / <sub>8</sub>									2 <sup>7</sup> / <sub>8</sub> 2 <sup>7</sup> / <sub>8</sub> 4 <sup>7</sup> / <sub>8</sub> 4 <sup>7</sup> / <sub>8</sub>		
D	10 12 14 16	7 8 10 11	10	18 <sup>1</sup> / <sub>8</sub>	16 <sup>7</sup> / <sub>8</sub>	9 <sup>7</sup> / <sub>8</sub> 11 <sup>7</sup> / <sub>8</sub> 13 <sup>7</sup> / <sub>8</sub> 15 <sup>7</sup> / <sub>8</sub>	16 <sup>5</sup> / <sub>8</sub>	15 <sup>3</sup> / <sub>4</sub>	16 <sup>1</sup> / <sub>2</sub>	11 <sup>1</sup> / <sub>4</sub>	20	14 <sup>5</sup> / <sub>8</sub>	2	46 <sup>3</sup> / <sub>4</sub>	4 <sup>7</sup> / <sub>8</sub> 4 <sup>7</sup> / <sub>8</sub> 6 <sup>7</sup> / <sub>8</sub> 6 <sup>7</sup> / <sub>8</sub>	39	18 x 17
Е	12 14 16	8 10 11				11 <sup>7</sup> / <sub>8</sub> 13 <sup>7</sup> / <sub>8</sub> 15 <sup>7</sup> / <sub>8</sub>									4 <sup>7</sup> / <sub>8</sub> 6 <sup>7</sup> / <sub>8</sub> 6 <sup>7</sup> / <sub>8</sub>		

#### **ECM Motor Amperage Ratings**

Unit	Motor	120V/1/60	208V/1/60	277V/1/60				
Size	hp	FLA	FLA	FLA				
B	1/ <sub>3</sub> 1/ <sub>3</sub> 1/ <sub>2</sub> 3/ <sub>4</sub>	5.0	3.3	2.6				
C		5.0	3.3	2.6				
D		7.7	5.0	4.1				
E		9.6	7.9	5.5				


FLA = Full Load Amperage, rated per the motor nameplate


All fan motors are single phase, same voltage as electric coil (when supplied), with exception that 277V motors are used with 480V, 3 phase coils (4 wire wye).

#### **Accessories (Optional)**


Che	eck 🗹 if provided.					
	Induced Air Filter, 1" thick, disposable construction type.					
	Fan disconnect switch (not ava	ilable	on units			
	Fibre Free Liner		1" EcoShield Liner			
	SteriLoc Liner		1" EcoShield Liner (Foil Face)			
	½" EcoShield Liner		1" Fibre Free Liner			
	½" Fibre Free Liner		Hanger Brackets			
	½" EcoShield Liner (Foil Face)		Cam Latch for Access Door			
	Fan unit fusing		OSP & IBC Certification			
	1" Fiberglass Liner					

### **Accessories (Optional)**

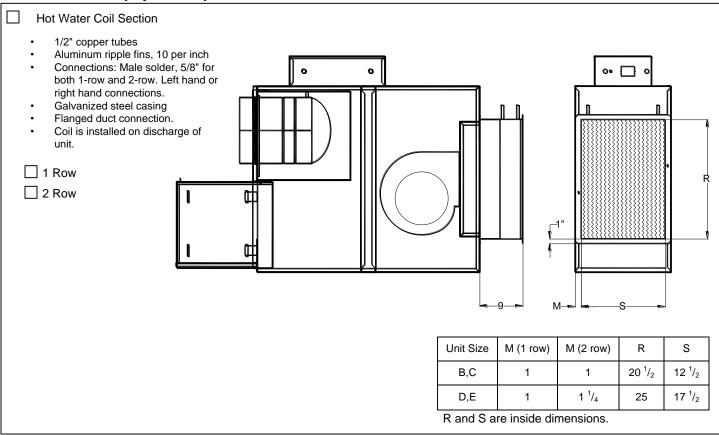

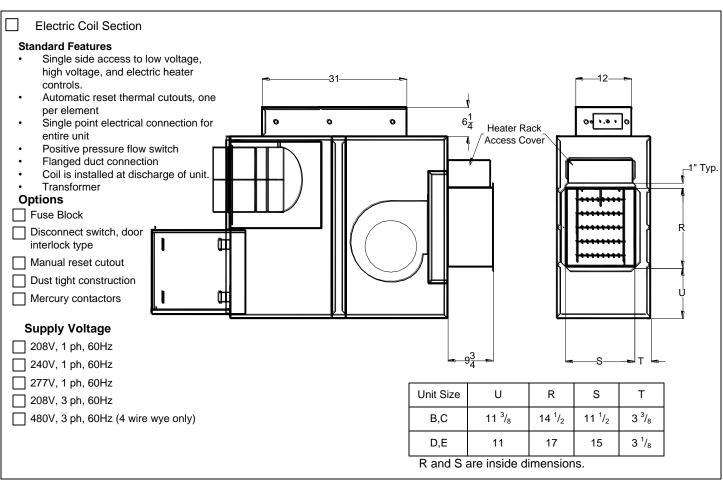

#### **Accessories (Optional)**

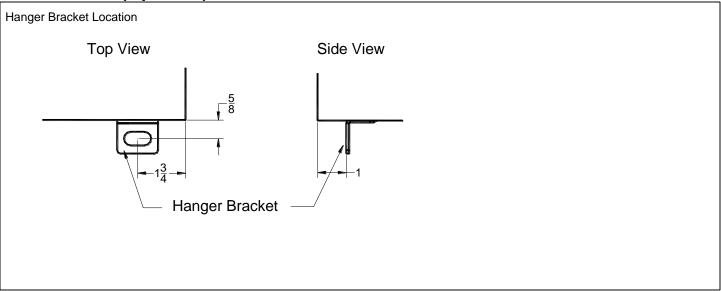

#### **General Description**

- Heavy steel casing, with leak resistant construction.
- Dual density insulation, coated to prevent air erosion, meet requirements of NFPA 90A and UL 181.
- Ultra high efficiency, brushless DC ECM motor with a unique microprocessor based motor controller.
- Manual PWM controller allows simple screwdriver adjustment of fan speed.
- Optional remote PWM controller allows for a 0-10 V signal from the DDC controller to adjust the fan speed.

- Efficiencies of up to 70% across the entire operating range.
- Provides a large turndown ratio
- Constant volume regardless of changes in downstream static pressure allows for factory setting of cfm.
- Patent-pending FAST™
   attenuator system that greatly
   reduces radiated sound power
   levels. The FAST™ attenuator
   ships assembled inside the
   casing, pulls out easily and snaps
   into place for operation.
- Top and bottom access panels can be removed for service.
- Multipoint, center averaging velocity sensor.

- Primary air flow balancing connections.
- Pressure independent primary flow control.
- Single point electrical connections.
- Rectangular discharge opening is designed for flanged duct connections.
- Electronic proportional room thermostat with adjustable setpoints for temperature and airflow is included with unit.
- Minimum and maximum airflow adjustments are made at the thermostat, using a digital voltmeter.
- Only Titus analog controls approved for seismic installation.
- OSHPD Seismic Certification: OSP-0352-10