


TO "DEC" TERMINAL ON EHM BOARD  
TO "INC" TERMINAL ON EHM BOARD  
TO FAN RELAY OR TO "24VAC" TERMINAL  
ON UNITS WITH ECM MOTOR (MANUAL PWM)

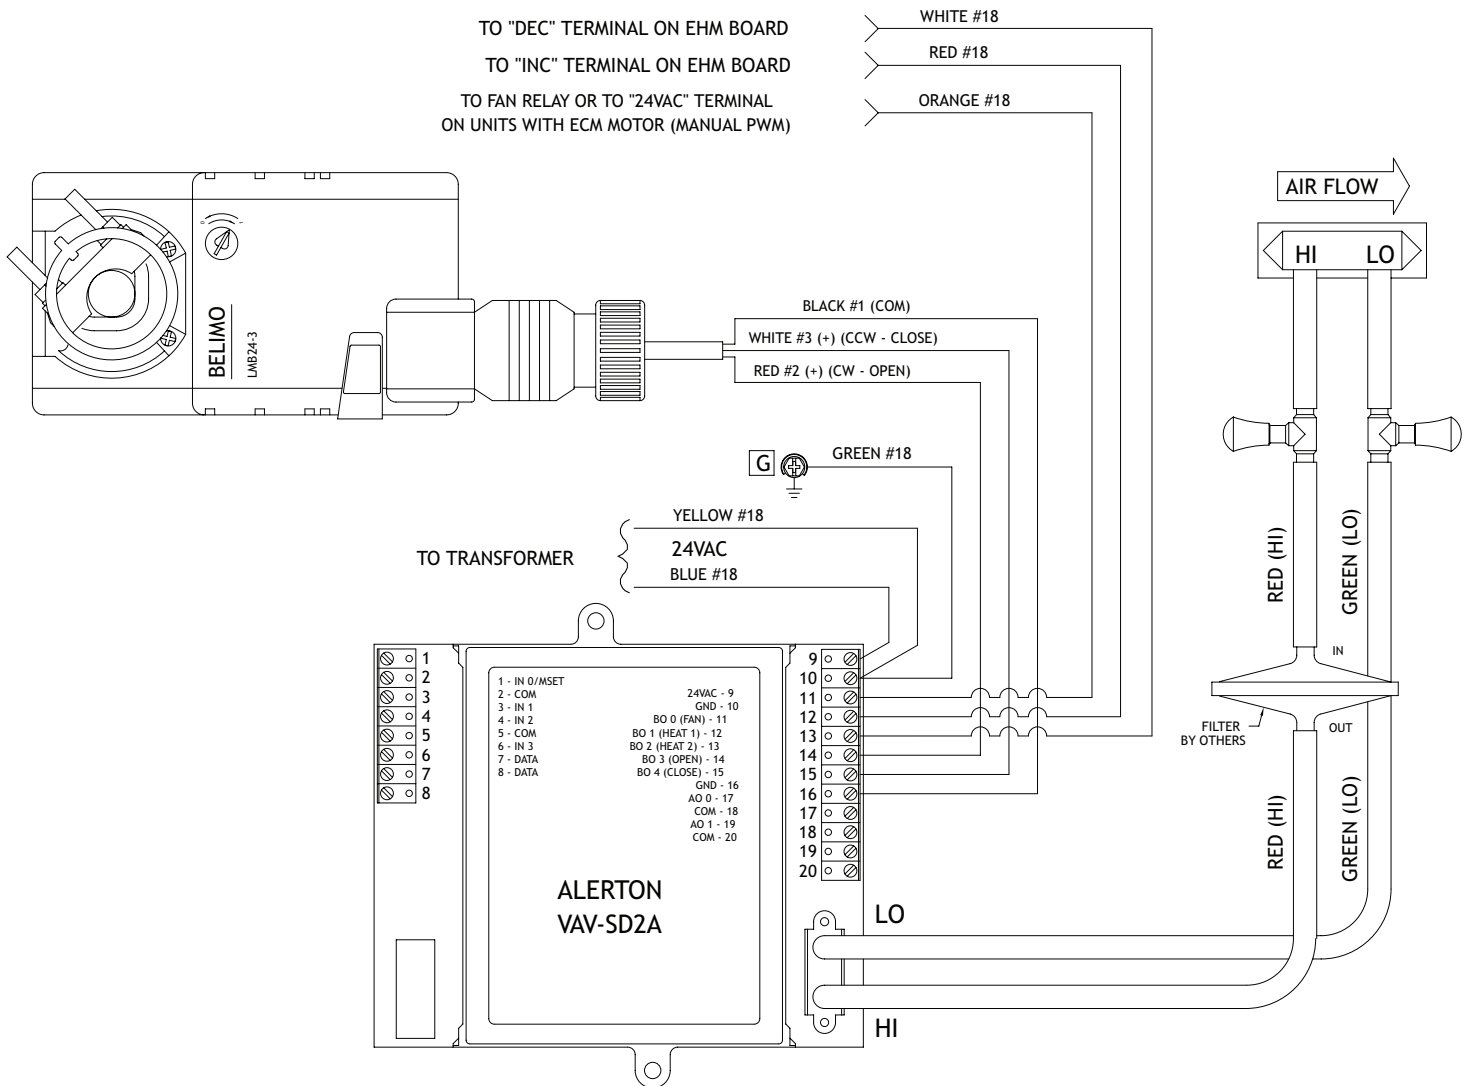

ACTUATOR NOTE: PRIOR TO LINKING DAMPER DEPRESS CLUTCH RELEASE BUTTON AND ROTATE ACTUATOR COLLAR FULLY CLOCKWISE. LINK DAMPER OPEN. MOTOR TURNS COUNTER CLOCKWISE TO CLOSE.

PROJECT:

ENGINEER:

CUSTOMER:

DATE:

SPEC. SYM.: