




FFD / FFDE / FFDB

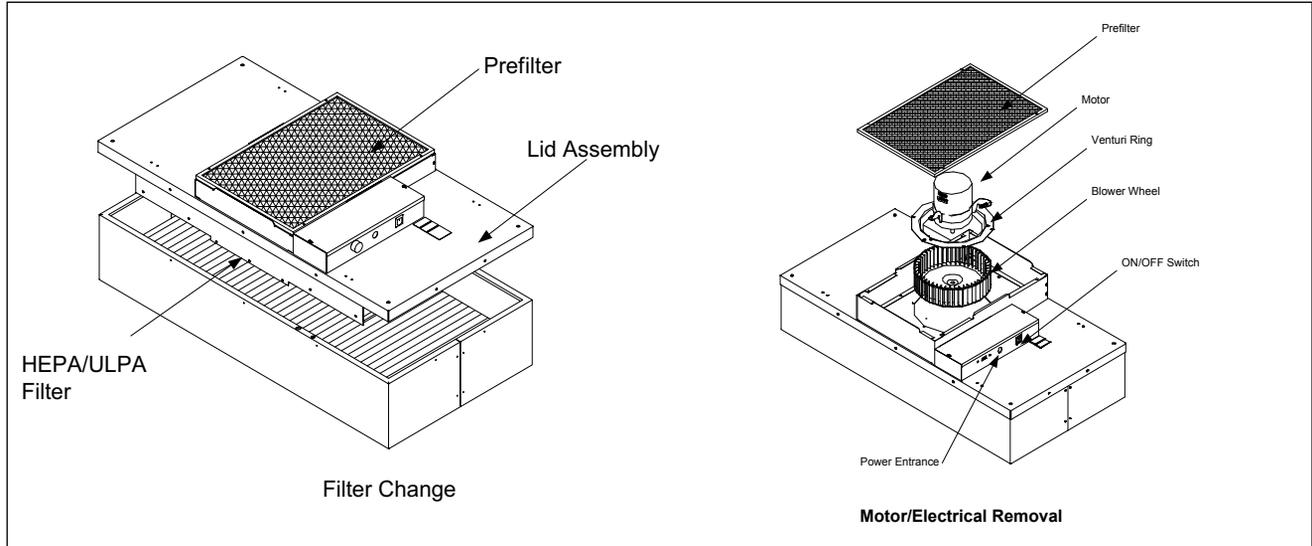

FFDR / FFDER / FFDBR

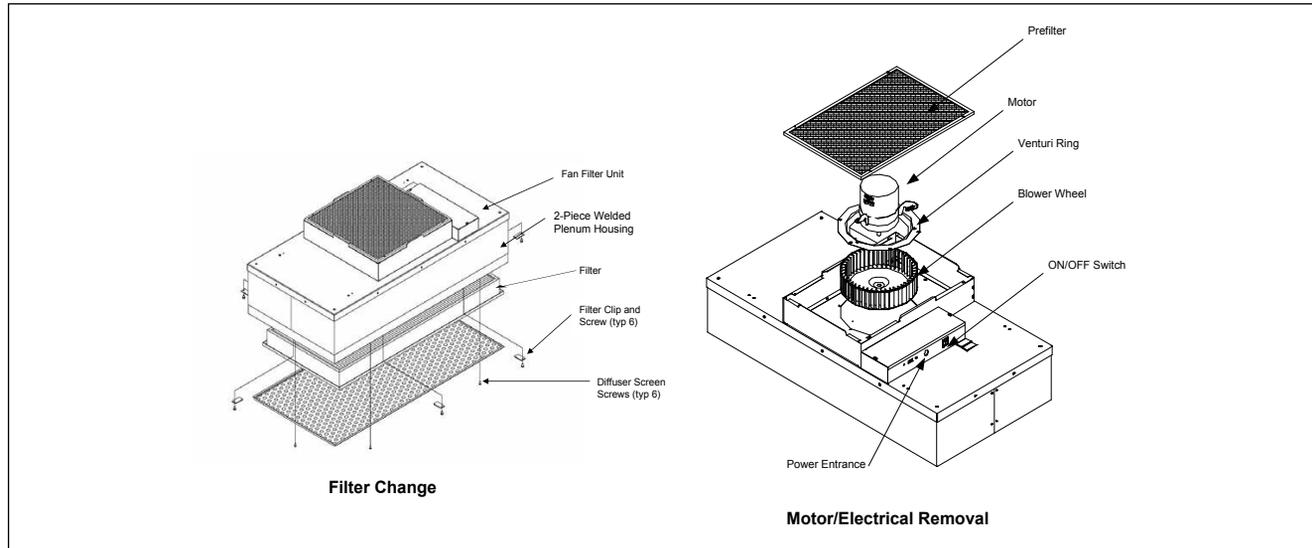

FFDRA / FFDERA / FFDBRA

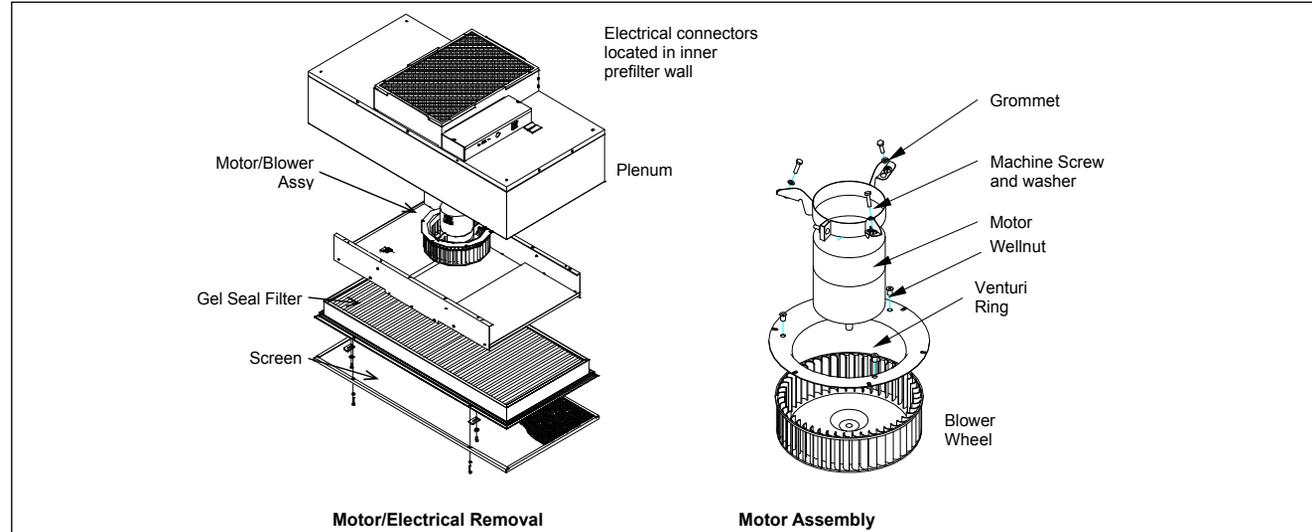


FILTER & GEL SEAL DETAIL

Lower housing is welded with full penetration welds providing a leak free mate to the gel seal filter. No caulk is required.





FFD / FFDE

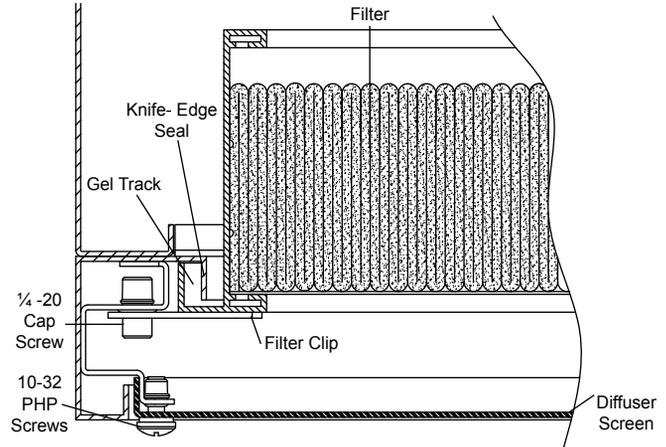


FFDR / FFDER / FFDR / FFDERA

CHALLENGE & COLLABORATION PORT DETAIL

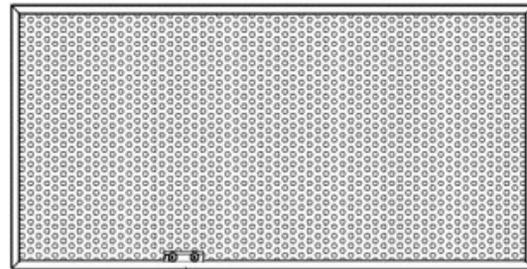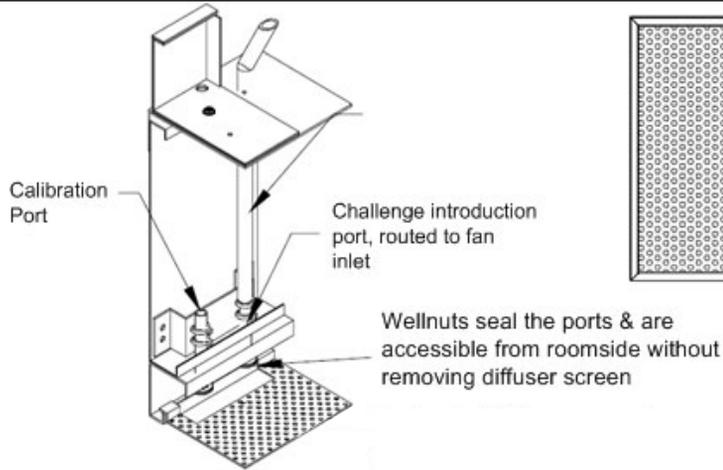

andard
odels.

ARRAY VIEW

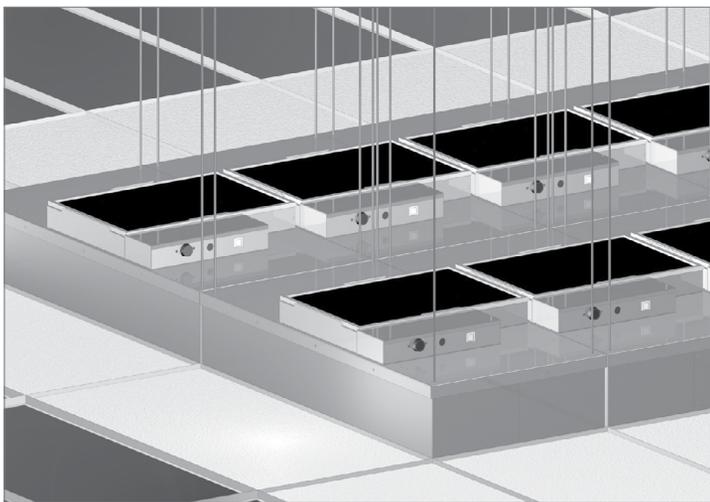

NOTES: Shown left is a typical installation of multiple fan filter units mounted above the service area, completely blanketing the critical area with clean, filtered supply air. For spot applications, a single fan filter unit can be mounted over a work bench or table to reduce particulate counts.